


SLOPE:

50:1 (2%)

12:1 (8%)

SETBACK - SIDEWALK APRON FOR 5' WALKS

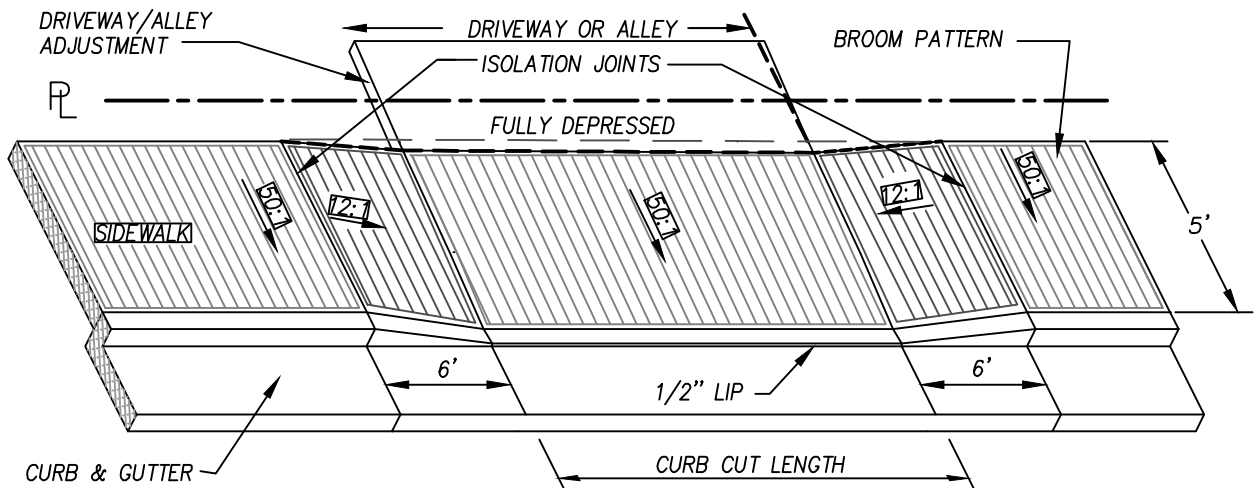

CURBSIDE - SIDEWALK APRON FOR 5' WALKS

NOTES:

1. ALL CONCRETE SHALL BE 6" INCH MINIMUM THICKNESS OF 3,300 psi. FIELD STRENGTH.
2. ADD JOINT IN CENTER OF APRON AND CURB & GUTTER WHEN APRON WIDTH EXCEEDS 20 FT.
3. ALL SLOPES ARE RELATIVE TO HORIZONTAL.
4. IF THE APRON WILL ALSO SERVE AS A SIDEWALK ACCESS RAMP IN PLACE OF A STANDARD RAMP, THE APRON SLOPE FROM THE GUTTER TO THE SIDEWALK SHALL BE 12:1 OR LESS WITH NO LIP.
5. ALL SLOPES AND GRADES TO COMPLY WITH CURRENT ADA REQUIREMENTS.



**CITY OF COBURG
STANDARD DRAWING**

**DRIVEWAY AND
ALLEY APRON
5' CURBSIDE
SIDEWALK**

DATE:
JANUARY 2017

DRAWING NO.
ST-106