


PLAN

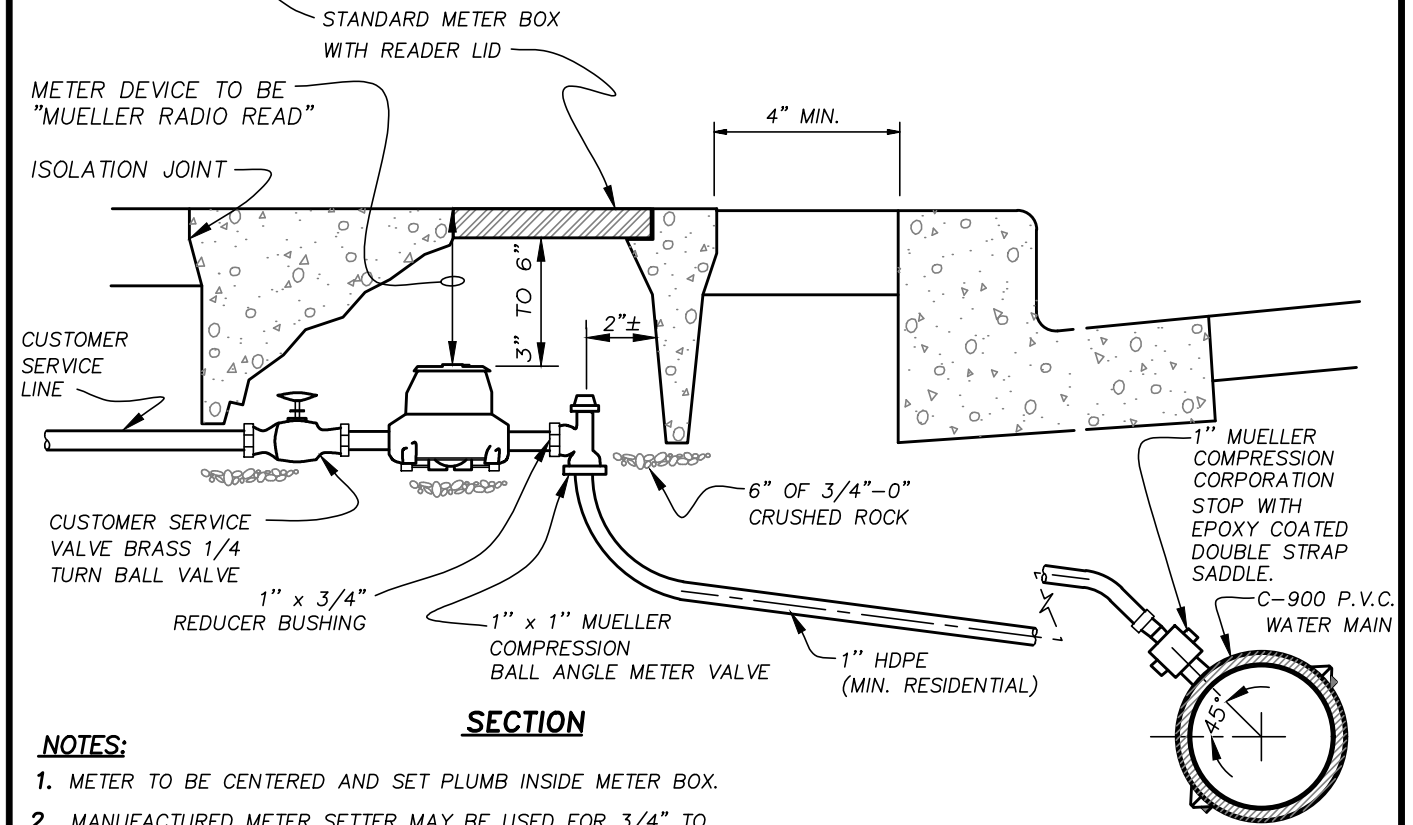

SECTION

NOTES:

1. METER TO BE CENTERED AND SET PLUMB INSIDE METER BOX.
2. MANUFACTURED METER SETTER MAY BE USED FOR 3/4" TO 2" SERVICES.
3. POLYETHYLENE SERVICE TUBING SHALL BE COPPER TUBE SIZE (CTS) AND RATED AT 200 PSI.
4. SET METER BOX 4" MINIMUM BEHIND CURB OR SIDEWALK.
5. METER BOXES SET IN DRIVEWAYS SHALL HAVE TRAFFIC LIDS.
6. CITY STANDARD "MUELLER" BRASS FITTINGS OR EQUIVALENT
7. CITY STANDARD METER BOX SHALL BE:
 PLASTIC - "CARSON" OR EQUIVALENT PC
 CONCRETE - "CHRISTY" OR EQUIVALENT



CITY OF COBURG STANDARD DRAWING	
3/4" TO 2" WATER METER SETTING DETAIL	
DATE: FEBRUARY 2022	DRAWING NO. WA-001