


30"L x 17"W VALVE BOX, COVER  
 LABELED SEWER, PROVIDE BOXES  
 WITH BOTTOMS WITH 3"  
 REMOVABLE MECHANICAL PLUG  
 WHEN WITHIN 10' OF WATER LINE  
 OR SERVICE. VALVE BOX SHALL  
 BE RATED FOR H-20 LOADING  
 OR GREATER.

FULL PORT UNIONIZED  
 PVC BALL VALVE AS  
 REQUIRED

TRANSPARENT,  
 UNIONIZED PVC  
 CHECK VALVE  
 AS REQUIRED.

VARIES DETERMINE  
 IN FIELD  
 RECOMMEND 18"

PRIVATE  
 PROPERTY

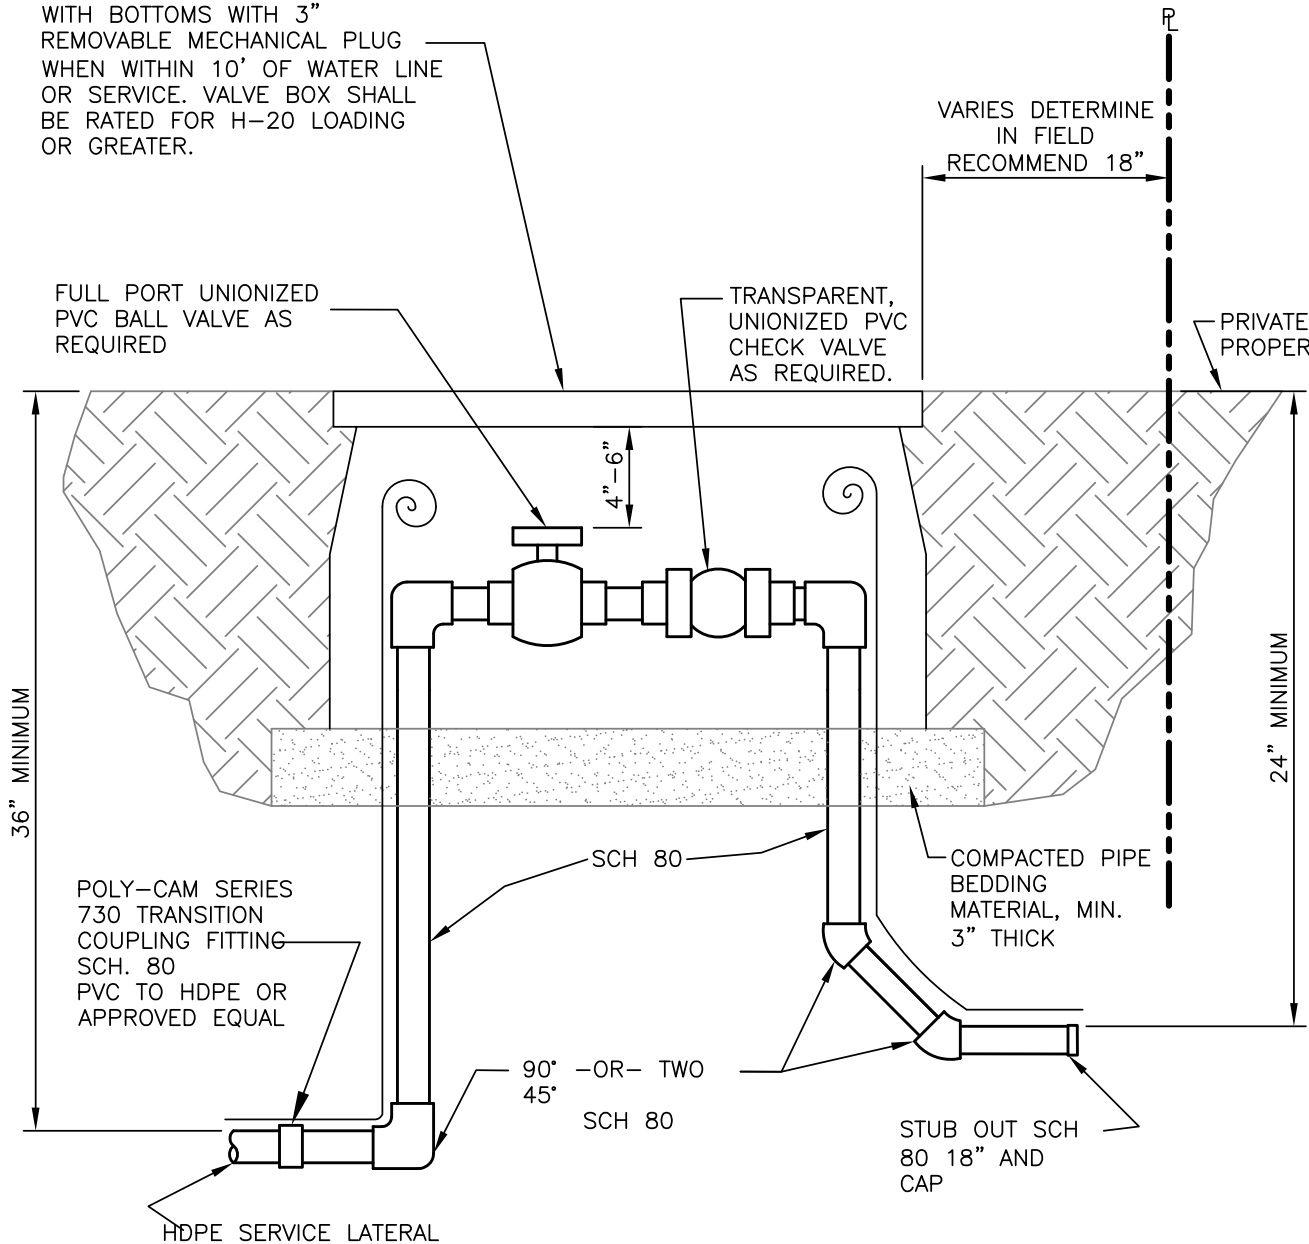

POLY-CAM SERIES  
 730 TRANSITION  
 COUPLING FITTING  
 SCH. 80  
 PVC TO HDPE OR  
 APPROVED EQUAL

SCH 80

COMPACTED PIPE  
 BEDDING  
 MATERIAL, MIN.  
 3" THICK

90° -OR- TWO  
 45°  
 SCH 80

STUB OUT SCH  
 80 18" AND  
 CAP

HDPE SERVICE LATERAL

GENERAL NOTES: HDPE SERVICE LATERAL,  
 1.25" RESIDENTIAL, 2" COMMERCIAL,  
 DR11. TONING WIRE, COIL MINIMUM OF  
 2' INSIDE BOX. ALL PVC TO BE SCH 80.

CITY OF COBURG  
 STANDARD DRAWING

TYPICAL  
 SANITARY SEWER  
 SERVICE BOX



DATE:  
 JANUARY 2017

DRAWING NO.  
 WW-001